

# INDUSTRY HOSE STATION

Submittal Data Sheet S-150A-LF  
August, 2018

## SW-75-E-LF-HDHR-50HDH-N2-SIGN

- Manual Steam & Water Blender
- 3/4" IPS Steam (or hot water) inlet, 3/4" IPS cold water inlet
- Two stop and check valves with color-coded heat-resistant handles on inlets (internal parts of stainless steel construction)
- Mixing chamber with steam jet, (stainless steel)
- Hose connection
- Rough finish
- 40 PSI (2.8 bar) minimum operating pressure
- 80 PSI (5.5 bar) maximum operating steam pressure
- 125 PSI (8.5 bar) maximum operating water pressure

### ACCESSORIES


- N2 - Standard Hose Nozzle
- SC - Spring Clip
- HDHR - Heavy Duty Hose Rack, welded construction, 1/4" saddle, 1/8" stainless steel face and backplate
- 50 HDH - Heavy Duty Hose, fifty feet, 3/4" EDPM cream color cover, high temperature resistant
- OSHA approved safety sign

### OPTIONAL ACCESSORIES

- N2-SS - Body and internal parts of stainless steel
- SP - Stainless Steel Spring protector, furnished on one end of hose
- SW - Bronze Swivel attachment on hose
- VB - Vacuum Breaker
- D - Dial thermometer

Note: Leonard Valve Company reserves the right of product, or design modifications without notice or obligation.

**Valve assembly is Third Party certified to meet national Low Lead requirements of AB 1953 where wetted surface area is required to be less than 0.25% lead by weight.**

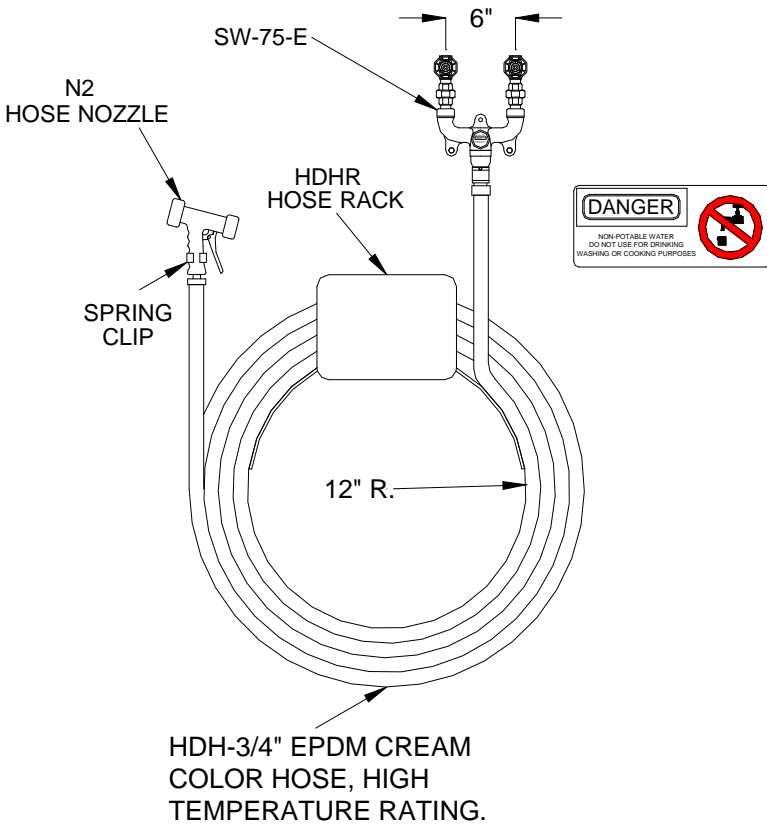

<b>Job #</b> _____ <b>Arch/Eng.</b> _____ <b>Contractor</b> _____	<b>Engineer's Approval</b>
<b>IMPORTANT!</b> Not for use with steam pressures above 80 PSI (5.5 bar). The prevailing steam (or hot water) pressure must be slightly lower than the cold water pressure. Not for use with unequal pressures. Install pressure reducing valves where unequal pressure conditions exist.	
<b>CAUTION:</b> These valves may pass live steam under certain circumstances. Follow recommended operating instructions and wear protective clothing when using.	



**WARNING:** This product can expose you to chemicals including lead, which is known to the State of California to cause cancer. For more information, go to [www.P65Warnings.Ca.gov](http://www.P65Warnings.Ca.gov)



1360 Elmwood Avenue, Cranston, RI 02910 USA  
 Phone: 401.461.1200 Fax: 401.941.5310  
 Email: [info@leonardvalve.com](mailto:info@leonardvalve.com)  
 Web Site: <http://www.leonardvalve.com>