




NUCLEUS
DIGITALLY CONTROLLED MIXING VALVE

MEGATRON® MODEL M-PNV-200-LF-2PS-LC
DIGITAL TEMPERATURE
CONTROL STATION

Submittal S-PNV-200-LF-2PS-LC-M
August, 2026

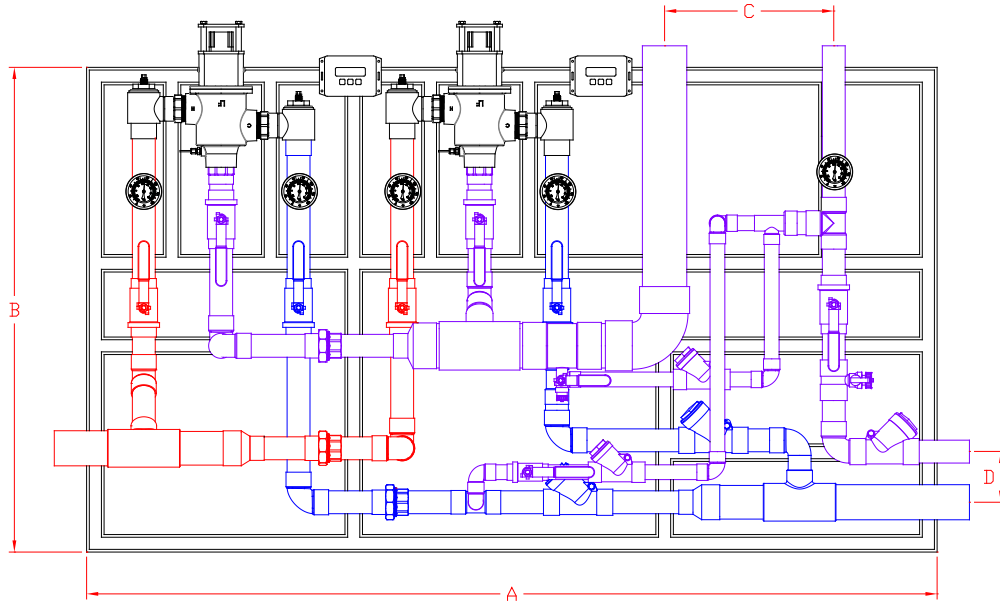

APPROXIMATE DIMENSIONS
A = 6'-7" B = 3'-9" C = 1'-4" D = 5"
Image not to scale

- Digital Mixing Valve with 2" inlet checkstop valves, 2" Outlet with ball valve and integral RTD Sensor per valve
- Manifold Assembly with 3" inlets, 4" outlet, 2" Return piping (101.6mm, 101.6mm, 50.8mm)
- 0.25 GPM** (0.95 L/min) minimum flow capacity per valve
- Controls water temperature to $\pm 2^\circ\text{F}$ in accordance with ASSE 1017
- Controls water temperature to $\pm 2^\circ\text{F}$ at the PNV-200-LF during times of low/no system demand
- Maximum operating pressure: 200 PSIG (1379KPA)
- Automatic Hot/ Cold Water shutoff upon cold/ hot water inlet supply failure
- User programmable for on-site configuration
- User programmable set point range between 65°F and 180°F
- Displays outlet temperature
- UL Listed 120V plug in power supply with 6' cord (1 per valve)
 - Option for Backup Uninterruptable Power Supply in the event of primary power loss w/ approx. two hours run time
- Factory assembled and tested
- Not for use in process applications nor intended to deliver final temperature control
- Primary use as an ASSE 1017 Distribution Valve/Master Mixer in a Domestic Hot Water System when combined with proper downstream protection devices approved to ASSE 1016, 1069, 1070 or 1071

STANDARD CONTROL BOX



Valve assembly is compliant with Low-Lead requirements of wetted surface area containing less than 0.25% lead by weight. All other fittings and components, the sum total of which comprise the wetted surface of this product contains less than one quarter of one percent of lead by weight.

****NOTE:** The valve will maintain temperature with 0.25 GPM flow from the domestic hot water loop when properly installed near the hot water source with a continuously operating recirculation pump.

NEW "ENHANCED FEATURE SET" CONTROL BOX

SEE SELECTABLE OPTIONS PAGE 2



Valves are ASSE 1017 Certified



Valves are CSA Certified



Valve electronics are UL Certified



See page 2 for Control Box options
See page 3 for Specification Detail
See page 4 for Piping Method Detail & Flow Capacity Chart
See page 5 for further options



1360 Elmwood Avenue, Cranston, RI 02910 USA

Phone: 401.461.1200 Fax: 401.941.5310

Email: info@leonardvalve.com


Web Site: <http://www.leonardvalve.com>

PNV-CONTROLLER OPTIONS

Standard Controller 1.0 Version



A = 6" B = 4"
Depth = 1-3/4"



STANDARD CONTROLLER:

_____ **1.0** – See PAGE 1 for info

ENHANCED CONTROLLER OPTIONS:

_____ **2.0** – Enhanced Proton Controller with Programmable Disinfection Mode


Options:

- _____ **3T**– Three Additional Temperature Sensors for Monitoring of Inlet Hot, Inlet Cold, and Return Temperatures
- _____ **REL** – 5 Relay Contacts that Switch during Alarm State
 - Helpful for Remote Alerts Within Building to Assist Maintenance and Service Personnel
 - 5 Unique States:
 - Loss of Power
 - Broken Temperature Probe
 - “Out of Range” Temperature ($\pm 10^{\circ}\text{F}$)
 - Motor Connectivity and Operation
 - Maintenance (Service Required) @ <90% Full travel

Enhanced Controller 2.0, 2.5, 3.0 Versions



A = 8" B = 4-3/4"
Depth = 1-1/4"



_____ **2.5** – Enhanced Proton Controller including all of 2.0 as well as BACnet MS/TP Connection which provides ability to serve up all data to BMS system

Options:

- _____ **3T** – Three Additional Temperature Sensors for Monitoring of Inlet Hot, Inlet Cold, and Return Temperatures
- _____ **REL** – 5 Relay Contacts that Switch during Alarm State (as shown above)

_____ **3.0** – Enhanced Proton Controller including all of 2.5 as well as all items below as standard,

- WiFi – Wifi enabled
- 3T - 3 Additional Temperature Sensors for Monitoring of Inlet Hot, Inlet Cold and Return Temperatures
- REL - 5 Relay Contacts that Switch during Alarm State



1360 Elmwood Avenue, Cranston, RI 02910 USA


Phone: 401.461.1200 Fax: 401.941.5310

Email: info@leonardvalve.com

Web Site: <http://www.leonardvalve.com>

LEONARD MEGATRON® MODEL M-PNV-200-LF-2PS-LC DIGITAL TEMPERATURE CONTROL STATION

Image not to scale

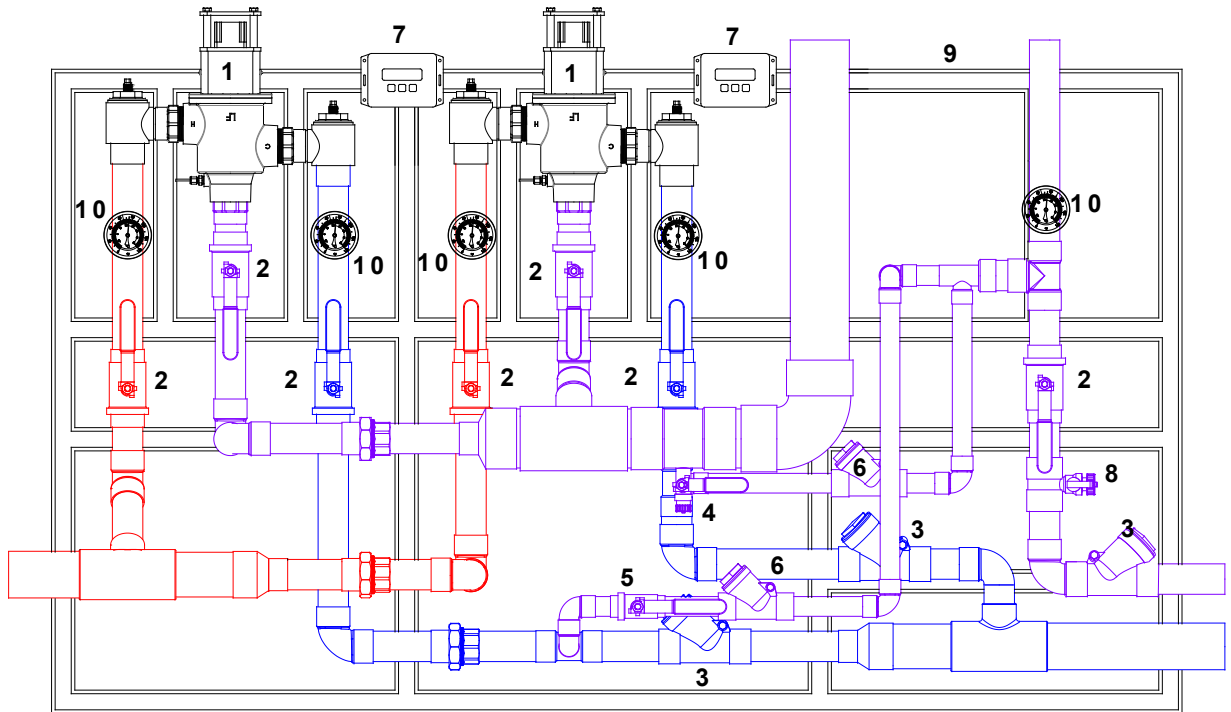

1. PNV-200-LF VALVE ASSEMBLY
2. 2" FULL PORT BALL VALVE
3. 2" CHECK VALVE
4. $\frac{3}{4}$ " TEST CONNECTION
5. 1-1/4" FULL PORT BALL VALVE

6. 1-1/4" CHECK VALVE
7. PROTON BOX
8. BOILER DRAIN CONNECTION
9. STRUT
10. DIAL THERMOMETER



1360 Elmwood Avenue, Cranston, RI 02910 USA

Phone: 401.461.1200 Fax: 401.941.5310


Email: info@leonardvalve.com

Web Site: <http://www.leonardvalve.com>

MEGATRON® MODEL M-PNV-200-LF-2PS-LC

2" RETURN PIPING METHOD W

Image not to scale

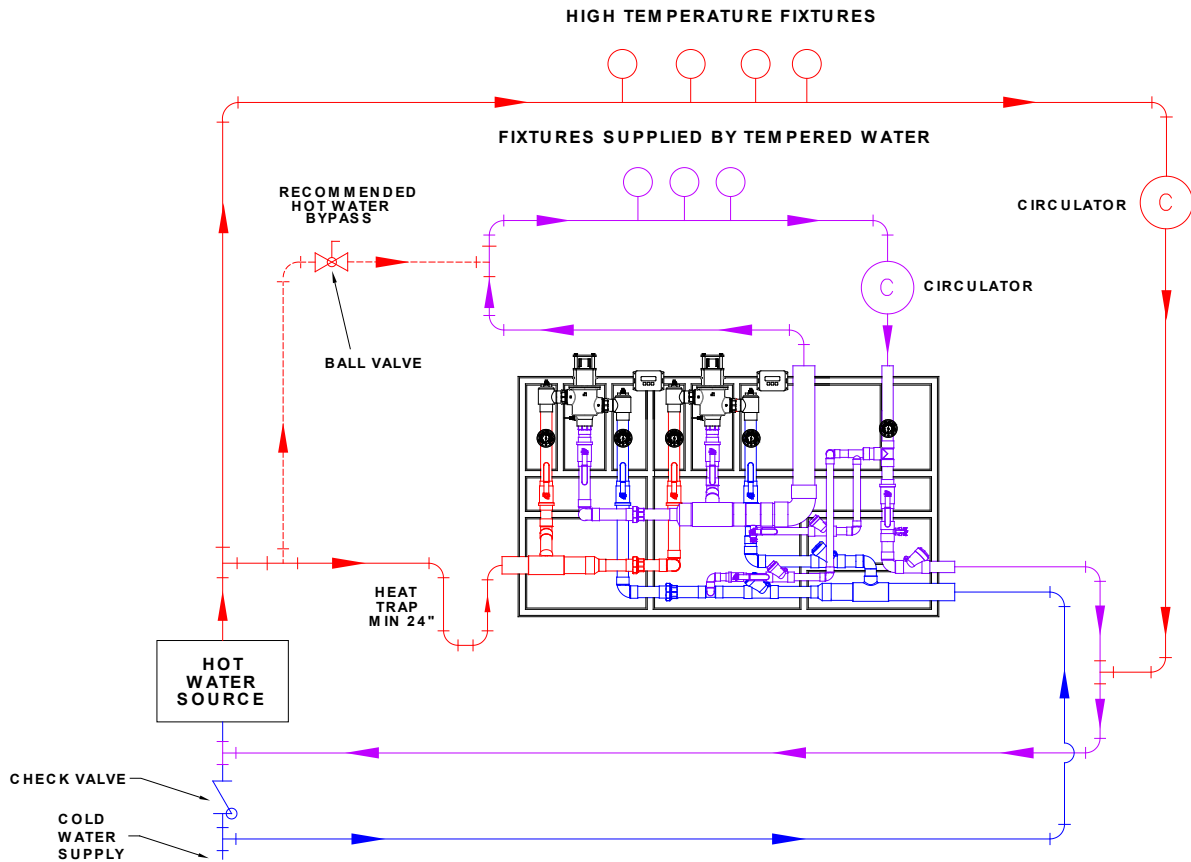

MODEL PNV-200-LF

Single Valve Flow Capacity

MINIMUM FLOW (GPM) (l/min)	PRESSURE DROP										
	5	(10)	(15)	(20)	25	30	35	40	45	50	PSI
	.3	.7	.97	1.4	1.7	2.1	2.4	2.8	3.1	3.4	BAR
0.25** (.95)	80 303	115 435	130 492	147 556	165 625	173 655	189 715	198 750	215 814	226 856	GPM l/min

NOTE: Flowrates will vary depending on existing field conditions. Leonard Valve Company always recommends using CASPAK® sizing software for proper valve sizing and model number applications.

Flow Chart MUST BE DOUBLED for 2 valve parallel assemblies



1360 Elmwood Avenue, Cranston, RI 02910 USA

Phone: 401.461.1200 Fax: 401.941.5310

Email: info@leonardvalve.com

Web Site: <http://www.leonardvalve.com>

OPTIONS AND ACCESSORIES

ANY OPTION CHOSEN WILL ALTER PRICING – CONTACT LEONARD VALVE COMPANY FACTORY



____ BPS – Backup Power Supply

- Uninterruptable Power Supply with up to 2 hours run time in case of primary power loss

____ RP3 – 3” Return piping

ANY OPTION CHOSEN WILL ALTER PRICING – CONTACT LEONARD VALVE COMPANY FACTORY

CAUTION! All thermostatic water mixing valves have limitations. They will NOT provide the desired accuracy outside of their flow capacity range. Consult the Flow Capacity Chart and DO NOT OVERSIZE. Minimum flow must be no less than as indicated.

NOTE: Flow rates will vary depending on existing field conditions. Leonard Valve Company always recommends using CASPAK® sizing software for proper valve sizing and model number applications.

Engineer's Approval

Job # _____

Arch/Eng. _____

Contractor _____

Note: The models shown represent Leonard Products which are believed to be equivalent in type and function to items specified. Leonard Valve Company is not responsible for errors or omissions due to differences in interpretations of information provided. Leonard Valve Company reserves the right of product, or design modifications without notice or obligation.

Product is non-cancellable and non-returnable from date from order with factory. Signed submittal required with purchase order.



WARNING: Risk of cancer and reproductive harm from exposure to lead – See www.P65Warnings.ca.gov



1360 Elmwood Avenue, Cranston, RI 02910 USA

Phone: 401.461.1200 Fax: 401.941.5310

Email: info@leonardvalve.com

Web Site: <http://www.leonardvalve.com>